


Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
07.07.2026	THENI	DINAMALAR	Water demand due to supply once in 5 days

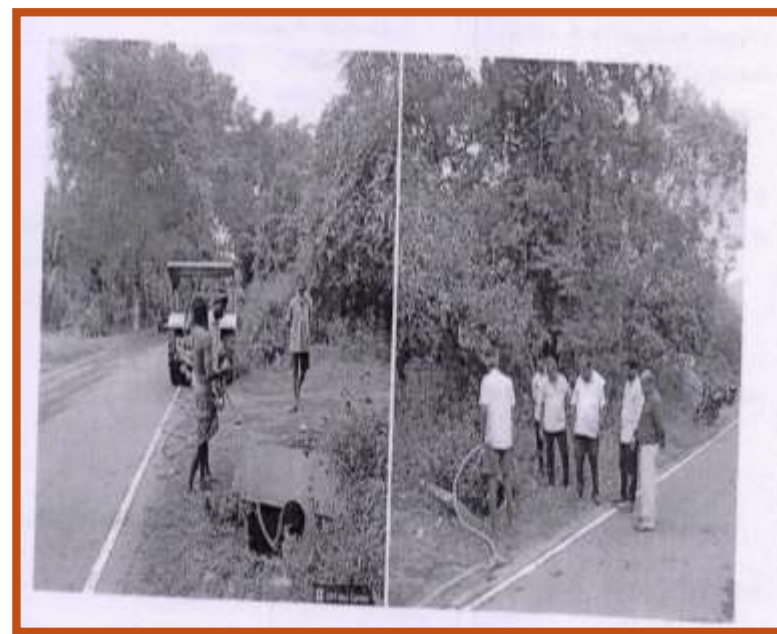

Damaged 300 mm PSC pipe leak was rectified and water supply effected on 08.07.2026 under Sootrupaarai CWSS in Theni district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
13.07.2026	DINDIGUL	DINAMALAR	Water leakage on road due to damage in distribution pipeline



Damaged 250mm AC pipeline was rectified on 13.07.2026 under **Dindigul CWSS** in **Dindigul district** .

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
13.07.2026	NAMAKKAL	DINAMALAR	Road protest by public demanding water , in Thiruchengode



Animoor panchayat is being provided with 7000 litres against the earmarked quantity of 5500 litres under **CWSS to Alampalayam and 669 habitations in Namakkal District** .

Also pipe leaks found in both TWAD Board and RD (distribution)pipes on 11.07.2026 was rectified on 12.07.2026.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
14.07.2026	THIRUVARUR	DINAKARAN	Vedaranyam CWSS water pipeline damaged



Water supply is being provided to Thiyagasamudram panchayat under **Vedaranyam CWSS** in Thiruvavarur district .
Issue due to the damaged 90mm PVC distribution pipeline of Thiyagasamudram panchayat which was rectified on 14.07.2026

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
15.07.2026	TENKASI	DINAMALAR	Pit formation in road due to water pipeline damage in Alwarkuruchi Theppakulam bus stop



Damaged 140mm PVC pipeline was rectified and water supply effected on 15.07.2026 under **CWSS to 163 habitations in Kadayam ,Pappakudi, Keelapavoor unions and Keelapavoor t.p (part) in Tirunelveli district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
15.07.2026	ARIYALUR	DINAMALAR	Kollidam CWSS water pipeline damaged in Jeyamkondam Main road



Damaged 600mm PE pipeline was rectified and water supply effected on 16.07.2026 under **CWSS to 227 habitations in Andimadam union and 13 habitations in Jayamkondam Union and 10 habitation in Thirumanur union of Ariyalur District.**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
16.07.2026	NAGAPATTINAM	INDIAN EXPRESS	Water leakage for the past 1 week in Vedaranyam – Thagattur – Thennadar salai



Damaged 180mm HDPE pipe was rectified and water supply effected on 16.07.2026 under Nagapattinam CWSS in Myladuthurai district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
16.07.2026	NAGAPATTINAM	DINAKARAN	Villagers block ECR over erratic drinking water supply



Damaged 90mm PVC pipeline was rectified and water supply effected on 16.07.2026 under **Vedaranyam CWSS Nagapattinam district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
17.07.2026	THENI	DINAMALAR	water stagnant looks like a pond



Damaged 140mm PVC pipeline was rectified and water supply effected on 17.07.2026 under **Kandamanur CWSS in Theni district** .

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
22/07/2026	DINDIGUL	DINAKARAN	Damaged Cauvery water pipeline



23.07.2026 அன்று 160 mm pvc குழாய் அணைப்பு சரி செய்யப்பட்டு புகைப்படம்

Damaged 160mm PVC pipeline is rectified and water supply effected on 23.07.2026 under **Natham CWSS in Dindigul district .**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
23/07/2026	THIRUVARUR	DINAKARAN	Road protest by public demanding water supply in Thiruthuraipoondi



Damaged 90 mm PVC pipeline was rectified and water supply effected on 23.07.2026 under **Vedaranyam CWSS in Thiruvavarur district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
23.07.2026	HOSUR	KALAIKATHI4R	Hoggenekkal water gussed out through Damaged air valve



Damaged air valve leak in the 450mm DI pipeline alignment was rectified and water supply effected on 22.07.2026 under Hogenakkal Water Supply and Fluorosis Mitigation Project in Dharmapuri and Krishnagiri district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
25/07/2026	THENI	DINAKARAN	Water distribution affected for 15 days in Andipatty



Damaged 63mm PVC was rectified and water supply effected on 25.07.2026 under Vallanathi CWSS in Theni district .

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
25.07.2026	TIRUPPUR	DINATHANTHI	People disguised as hunters for water



Water supply is being provided to Kumaralingam Town panchayat under CWSS to Madathukulam, Sankaramanallur, Komaralingam and Kaniyur Town Panchayat and 318 Rural Habitations in Udumalpet and Madathukulam in Tiruppur District with 1.49 MLD. Issue mentioned in newspaper is due to the borewell problems in Madathulam and the availability of 3 phase electricity is only provided in that region, the borewell is operated during that time alone

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
27.07.2026	MADURAI	DINAKARAN	Lakhs of water wasted due to damaged Cauvery water pipeline in Melur



200 mm PVC pipeline leak occurred near Thiruvalluvar Nagar from Melur Gandhi park sump to Sivagangai road. This leak was rectified and pumping resumed on 27.07.2026 under **Melur CWSS in Madurai district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
30.07.2026	THIRUVARUR	DINAKARAN	Public protest in Muthupettai – Thiruthuraipoondi ECR road



Leak in 900 mm MS pipeline is rectified and water supply effected on 01.08.2026 under Vedaranyam CWSS in Thiruvavarur district